


BACKFILL IN PAVED AREAS SHALL BE
CRUSHED STONE. SEE SPECIFICATIONS.

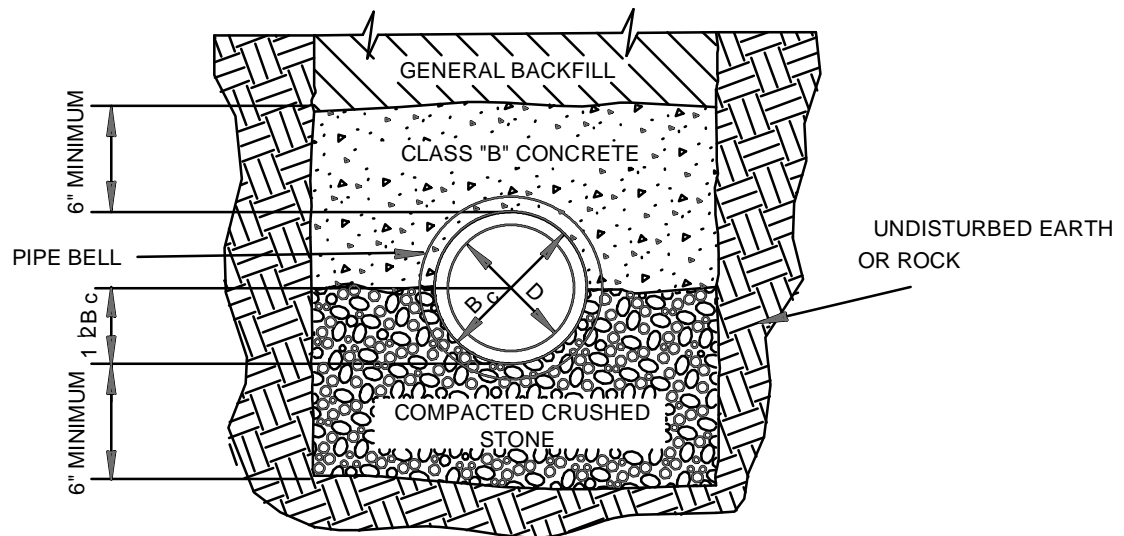

NOTES:

- 1) DETAILS ARE APPLICABLE TO
BOTH EARTH & ROCK TRENCHES.
- 2) COMPACTED CRUSHED STONE
SHALL BE SIZE NO. 67 AS
GIVEN IN SECTION 903
OF THE T.D.O.T. STANDARD
SPECIFICATIONS FOR ROAD &
BRIDGE CONSTRUCTION.

DRAWING NOT TO SCALE

MAY 27, 1994

DRAWN BY: M.H. & A.H.W.F.
APPROVED BY: K.N.H.

CONCRETE ARCH ENCASEMENT

STANDARD
DRAWING NO.

S - 22

MURFREESBORO WATER & SEWER DEPARTMENT

DATE REVISED: